


## Landfall Cable


*TKRA 300 kV 3x1200 mm<sup>2</sup> KQ + 2xFO*

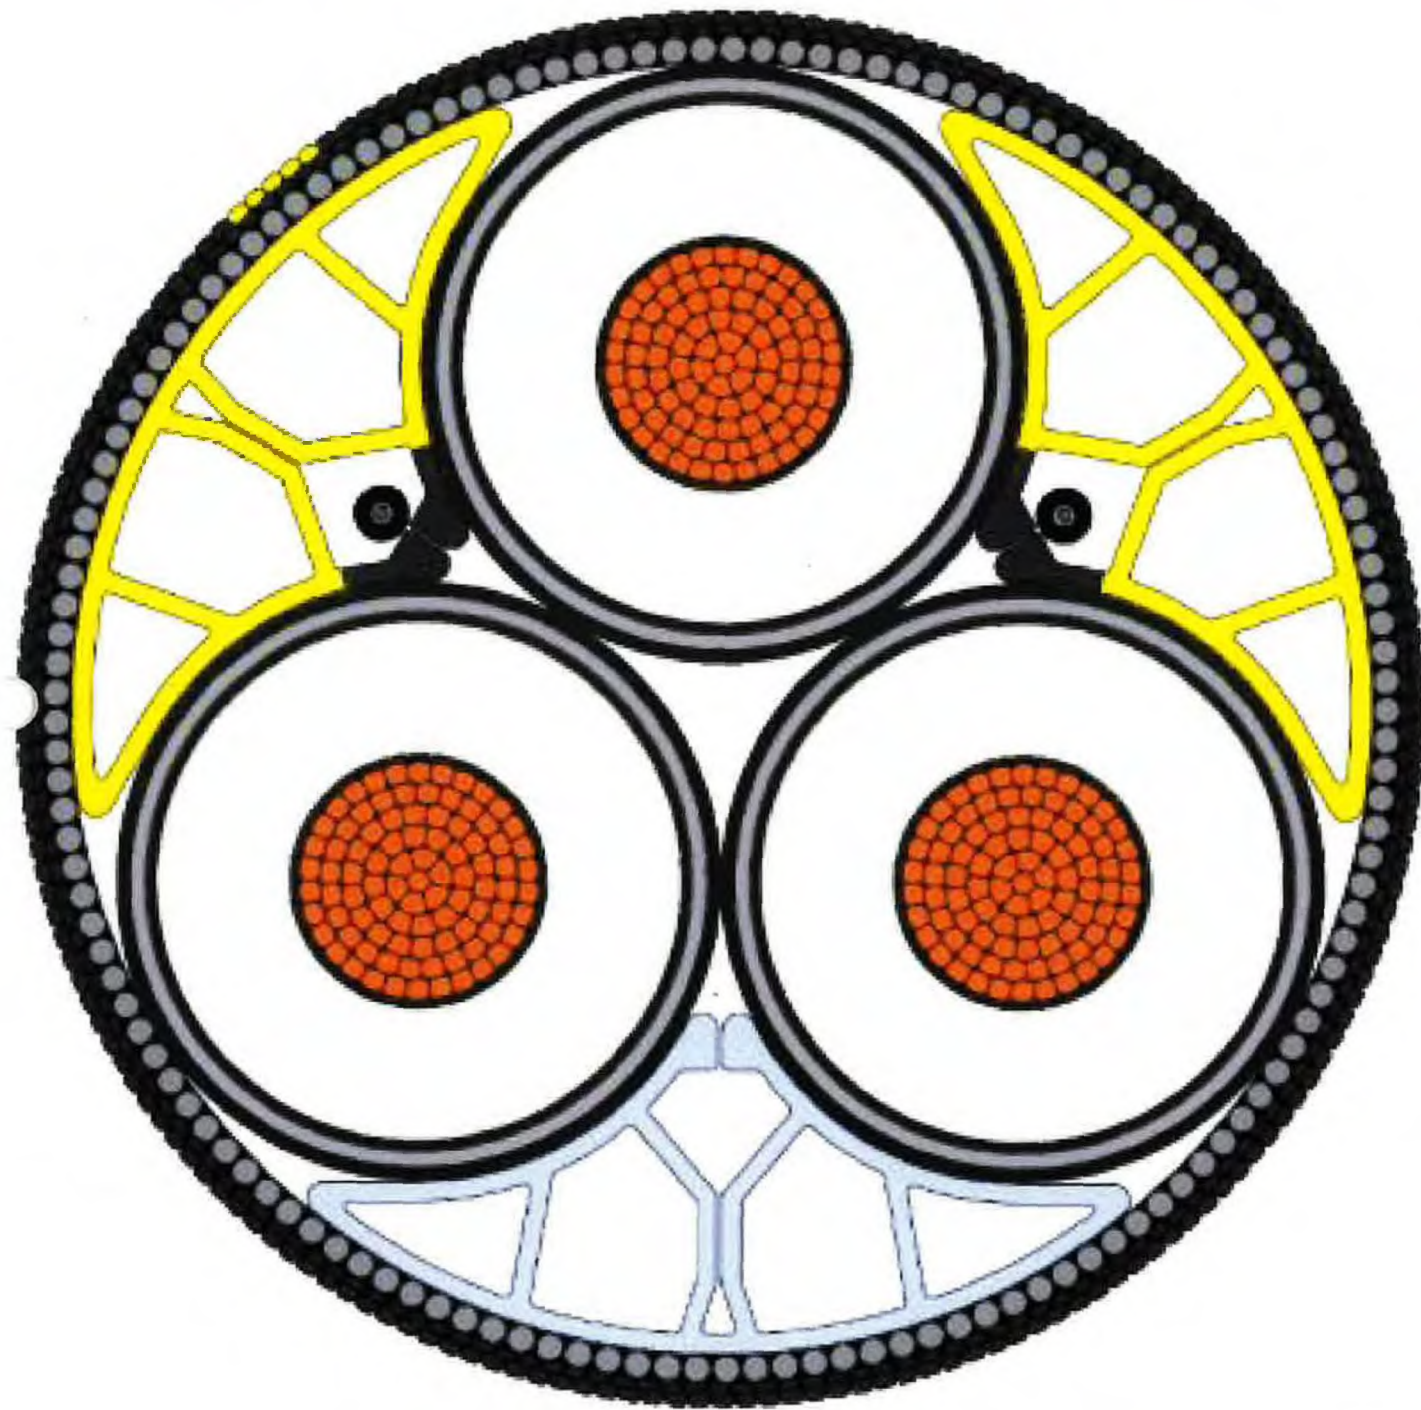

*The landfall cable will be used to transition from the offshore section to the transition joint bays.*

## Offshore Cable

*TKYA 300 kV 3x800 mm<sup>2</sup> KQ + 2xFO*

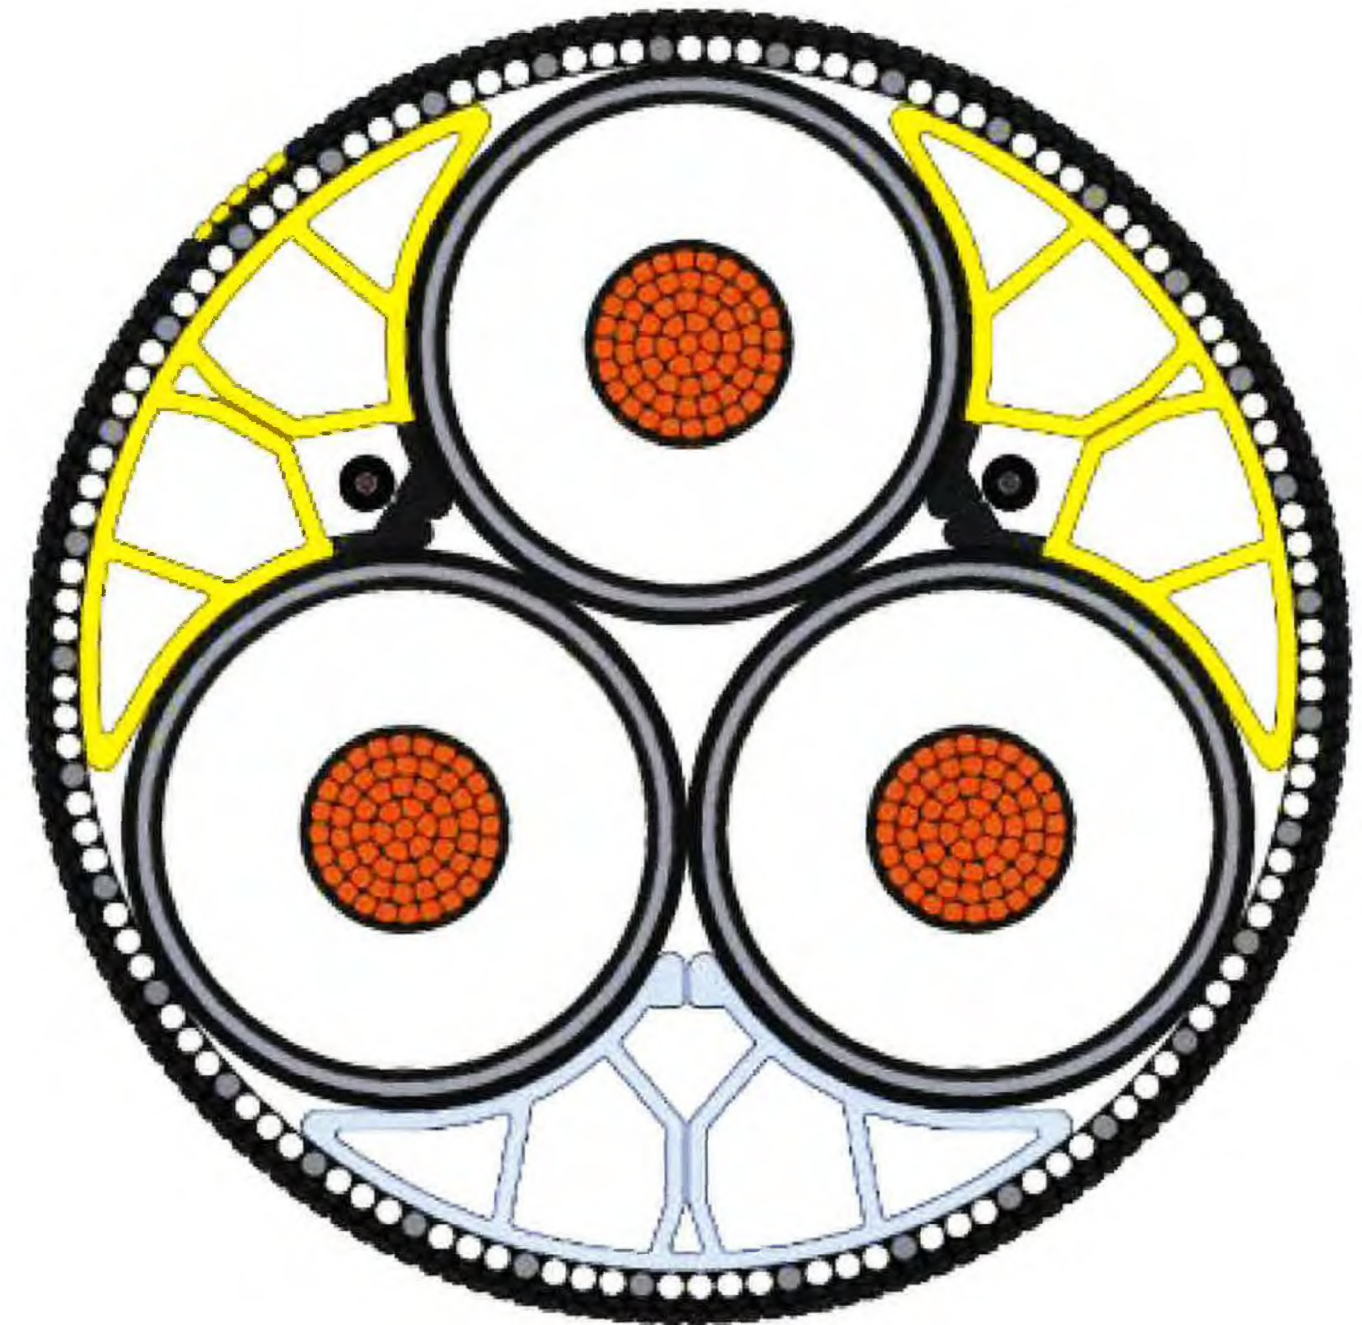

*The offshore cable will be used from the offshore end of the landfall to the OSS02, as well as the interlink cable between OSS01 and OSS02.*